



DTU, Department of Energy Engineering
s in [kJ/(kg K)], v in [m³/kg], T in [°C]
M.J. Stovrup & H.J.H. Kraadsen, 15-05-21

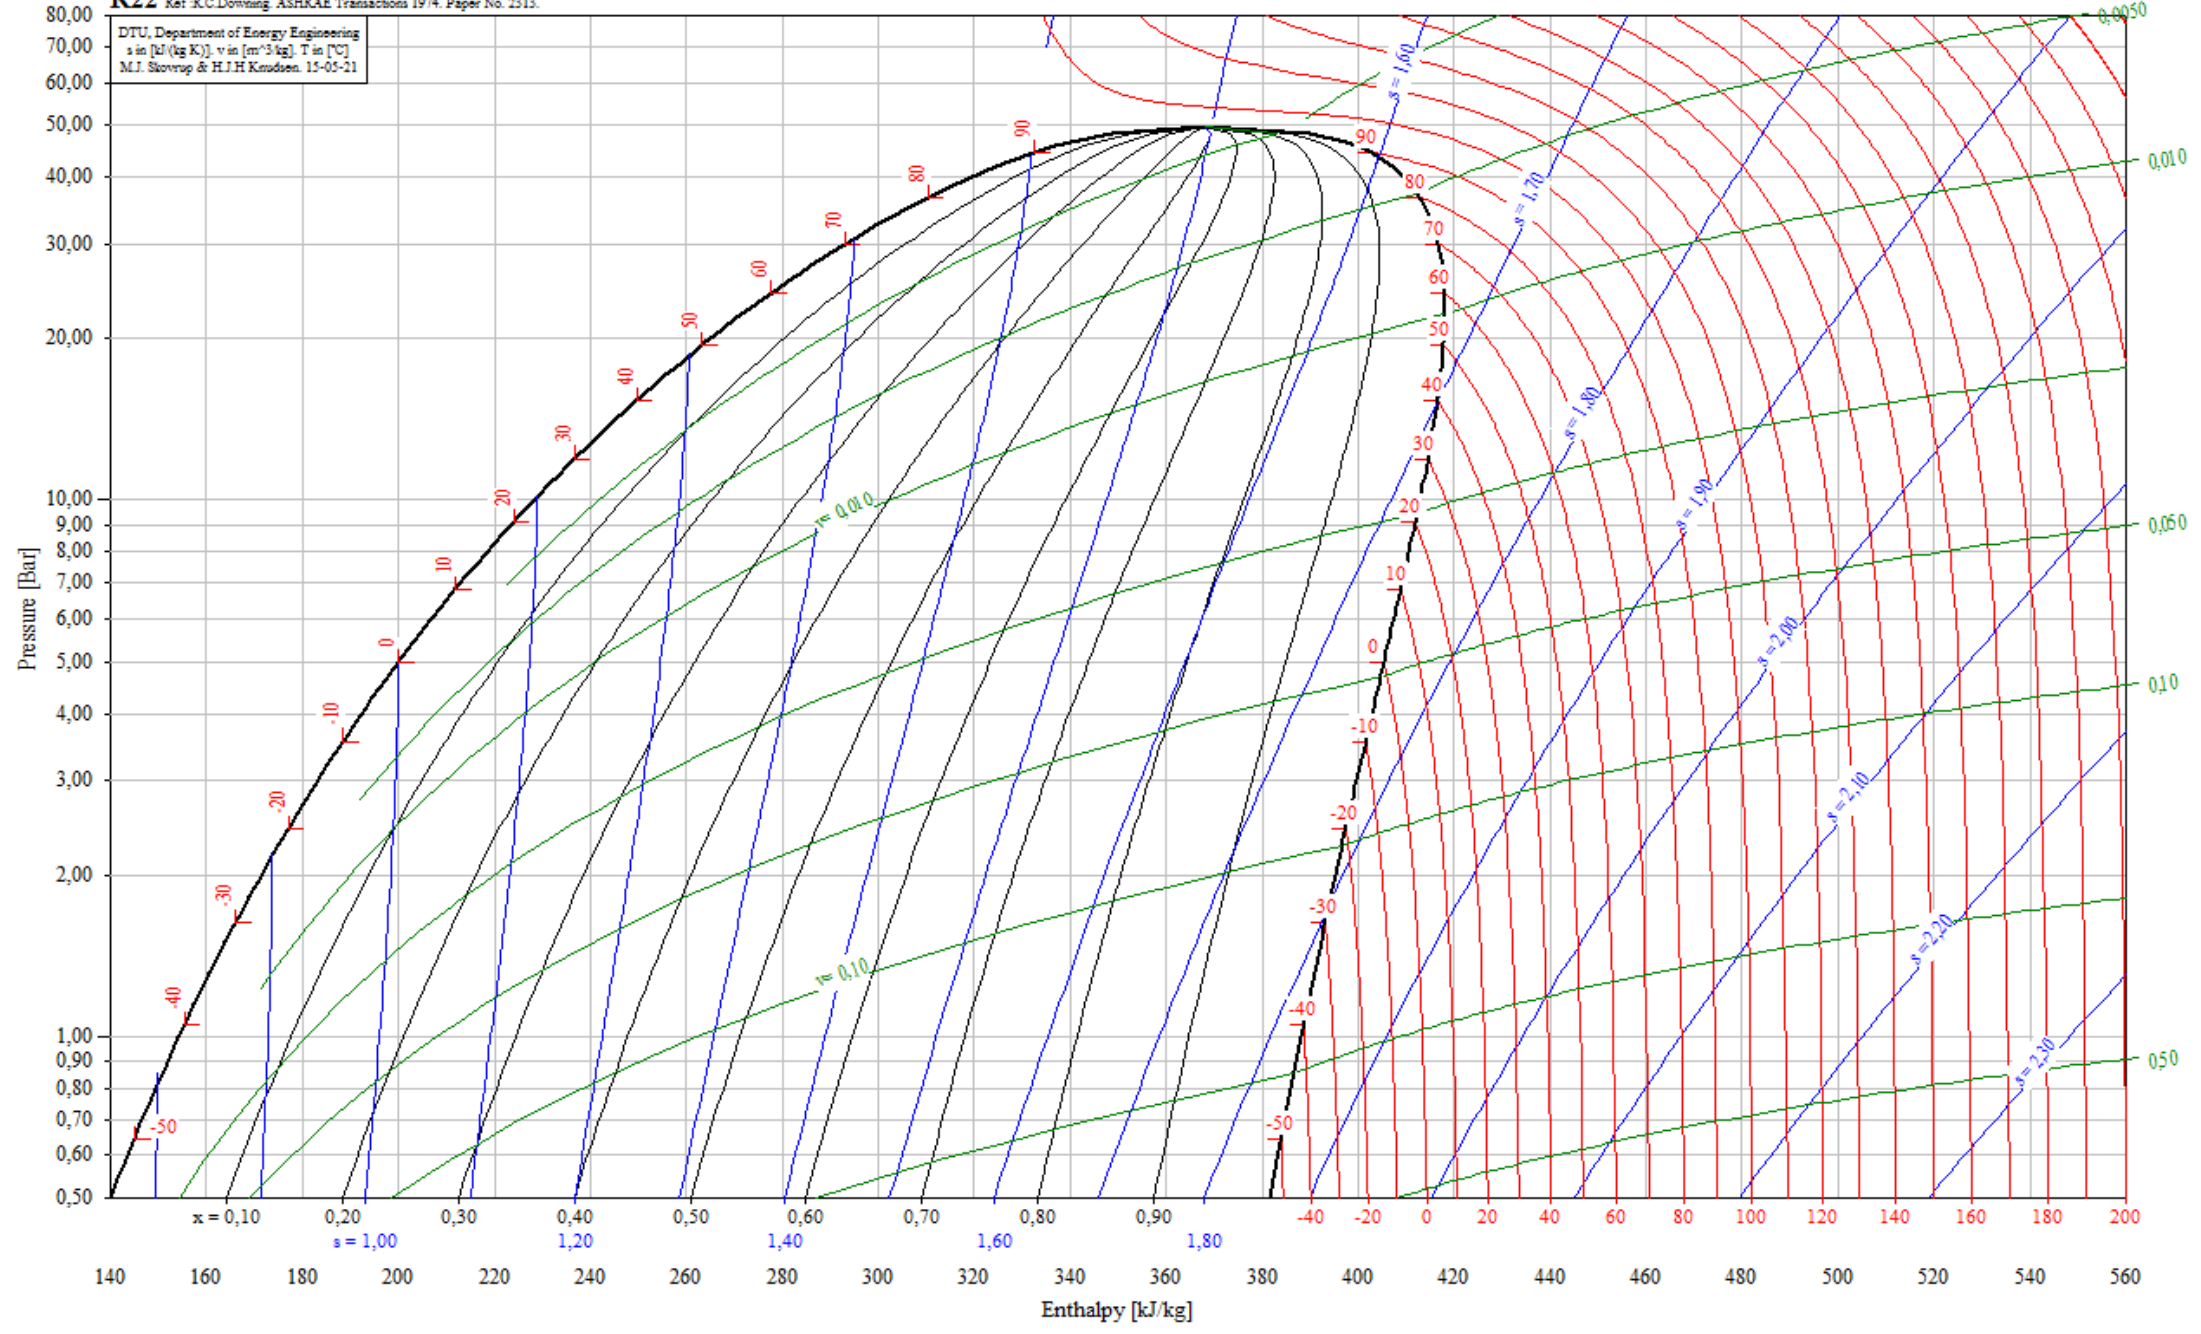

R134a Ref. D.P. Wilson & R.S. Bass, ASHRAE Transactions 1988, Vol. 94 part 2.

DTU, Department of Energy Engineering
s in [kJ/(kg K)], v in [m³/kg], T in [°C]
M.J. Skovrup & H.J.H. Knudsen, 15-06-01

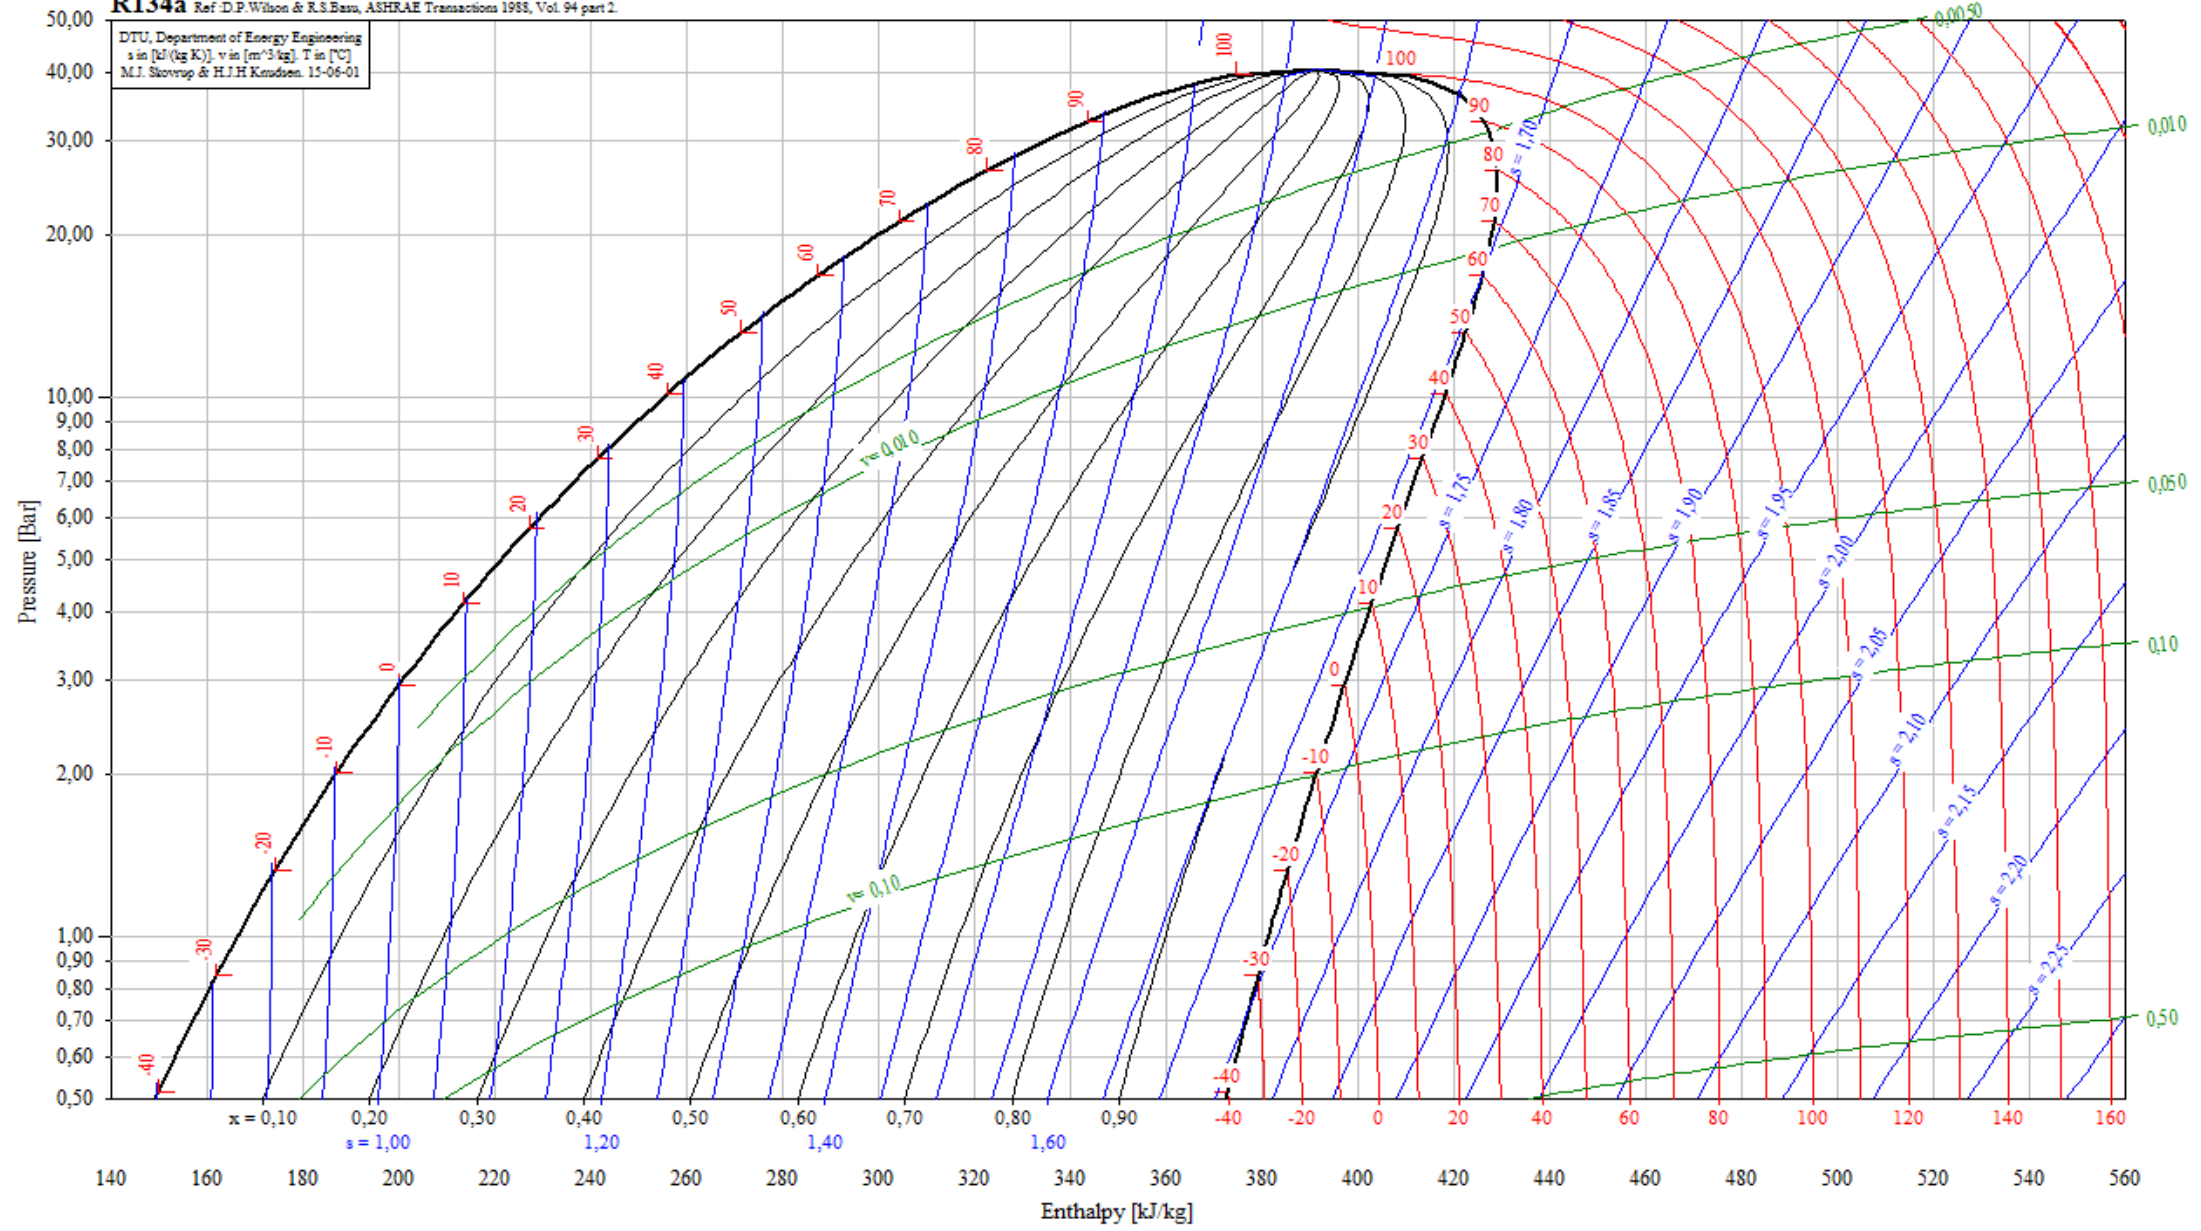

R717 Ref. R.Döring, Klima+Kälte ingenieur Ki-Extra 5, 1978

DTU, Department of Energy Engineering
s in [kJ/(kg K)], v in [m³/kg], T in [°C]
M.J. Slovrop & H.J.H. Knudsen, 15-06-01

